

SPECIFICATIONS

Frequency Response:

500-4,000 Hz ± 5 dB (see Figure 2)

Power Handling,

8 Hours, 6-dB Crest Factor:

30 watts (500-5,000 Hz pink noise)

Impedance,

Nominal:

8 ohms ID30C-8

16 ohms ID30C-16

Minimum, on Cobreflex Horns above 500 Hz:

7.5 ohms (850 Hz) ID30C-8

14 ohms (850 Hz) ID30C-16

Sound Pressure Level at 1 Meter:

1 watt input averaged, pink noise
band-limited from 500 to 5,000 Hz.
(see Table 1)

Voice-Coil Diameter:

3.81 cm (1.5 in.)

Magnet Weight:

0.28 kg (0.063 lb)

Magnet Material:

Strontium ferrite

Flux Density:

1.00 Tesla

Construction:

Rugged weatherproof finish for
outdoor use.

Mechanical Connection of Driver:

1 $\frac{3}{8}$ "-18x $\frac{1}{2}$ " long thread allows the
ID30 to be mounted on any University
Sound horn.

Dimensions,

Diameter:

10.6 cm (4.2 in.)

Height:

13.2 cm (5.2 in.)

Net Weight,

ID30C-8/16: 1.6 kg (3.5 lb)

ID30CT: 2.1 kg (4.5 lb)

Shipping Weight,

ID30C-8/16: 1.8 kg (4.6 lb)

ID30CT: 2.3 kg (5.8 lb)

Recommended Horns:

Cobreflex IIB

Cobreflex III

PH

2WP

HC400

SMH



**ID30C-8
ID30C-16
ID30CT**

**Medium-Power
Compression Drivers**

DESCRIPTION

The University Sound ID30C-8, ID30C-16 and ID30CT are heavy-duty compression drivers for use in medium-power public address installations.

The drivers employ rugged phenolic diaphragms, 1.5-inch diameter voice coils and "rim centered" ferrite magnet structures for long life and reliability under extreme operating conditions.

A weatherproof rear housing provides quick and easy access for connection using the sealed gland nut provided. Also featured is a plug-in, field replaceable diaphragm assembly.

The transformer model (ID30CT) includes connections for 25 V and 70 V distributed systems at any of six power levels.

The exterior parts are injection molded from polycarbonate, and all metal parts have been tropicalized for resistance to high-humidity and fungus.

Ideal for both indoor and outdoor applications, these drivers are well suited for any installation requiring rugged, medium-power performance.

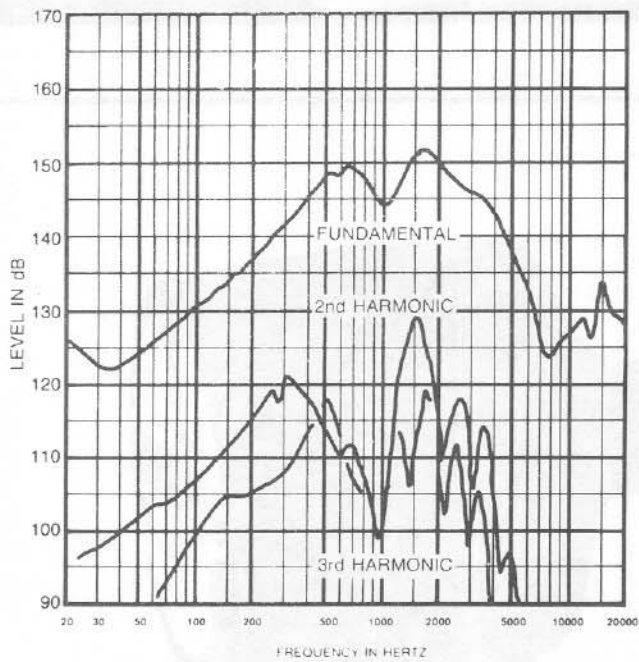


FIGURE 1
Distortion Response — Plane Wave Tube (1 inch)
(3-watt input)

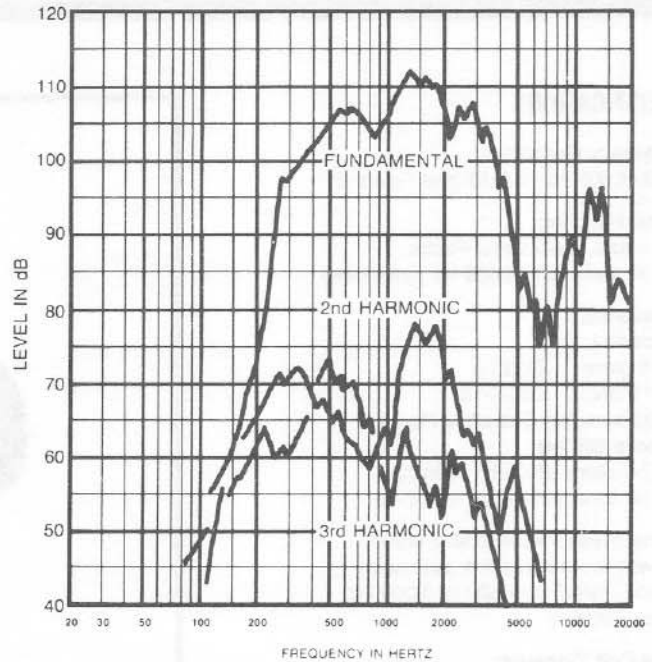


FIGURE 2
Distortion Response — Cobreflex III Horn
(1 watt/1 meter)

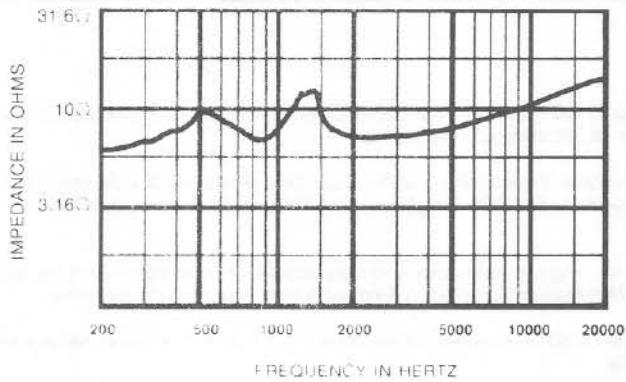


FIGURE 3
Impedance Response — Plane Wave Tube
(1 inch)

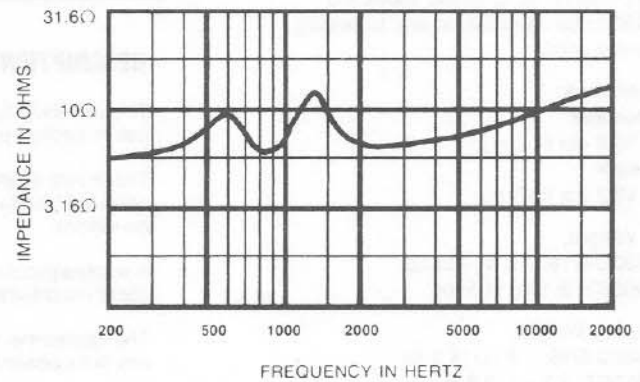


FIGURE 4
Impedance Response — Cobreflex III Horn

Horn	SPL for 1 W @ 1 M
Cobreflex IIB	106 dB
Cobreflex III	106 dB
PH	107 dB
2WP	102 dB
SMH	108 dB
HC400	105 dB

TABLE I
Sound Pressure Level for ID30
with Various Horns

INSTALLATION

Remove the plastic cap from the threaded throat of the driver and screw the driver into the horn until firmly seated.

Install the horn/driver assembly in intended location, referring to the instructions provided with the horn.

Remove the three screws from the rear of the driver housing and open the driver housing for access to the wiring.

Loosen the gland nut in the side of the driver housing enough to admit the loudspeaker wire/cable. Alternately, a 1/2-inch conduit fitting can be substituted for the gland nut. However, the sealing washer must be retained.

For the ID30CT connect the loudspeaker wires to the "com" terminal and the appropriate line terminal (25 V or 70 V). For the ID30C-8/16 connect to the black and white loudspeaker wire using wire nuts.

Tighten the gland nut securely and reassemble the rear housing and secure with three screws. Tighten the screws securely.

TRANSFORMER MODEL (ID30CT)

A transformer is installed in the base of the rear housing. Color coding for the transformer is listed in Table II. Transformer wiring with respect to Table II is illustrated by Figure 5.

	Wire Color	Function
Primary	Black	70.7V speaker system
	Red	25V speaker system
	White	Common for speaker system
Secondary	Purple	30W power tap
	Blue	15W power tap
	Green	10W power tap
	Orange	5W power tap
	Brown	2.5W power tap
	Yellow	1.25W power tap
	Gray	Common for transformer

TABLE II
Line Transformer

		70-Volt Lines		25-Volt Lines	
Power		Impedance	Capacitance	Impedance	Capacitance
30 W		167	5 mf	21	40 mf
15 W		335	2 mf	42	20 mf
10 W		500	1.3 mf	63	13 mf
5 W		1000	0.7 mf	125	7 mf
2.5 W		2000	0.4 mf	250	4 mf
1.25 W		4000	0.2 mf	500	2 mf

TABLE III — Series Protection Capacitors for 200 Hz and Below

LOW-FREQUENCY DRIVER PROTECTION

When frequencies below the low-frequency cut-off for the horn assembly are fed to the driver, excessive current may be drawn by the driver. For protection of driver, amplifier, and transformer (if driver with built-in transformer is used), capacitor(s) in series with driver, or transformer primary are recommended. Table III (above) indicates recommended values. The values shown are for 200 Hz. Values for other frequencies can be determined by using the formula:

$$C = \left[C_{200} \times \frac{200}{f} \right]$$

C_{200} = Values shown in the following table

f = New Frequency

For drivers without transformers:
8-ohm driver, 25 V – 100 mf

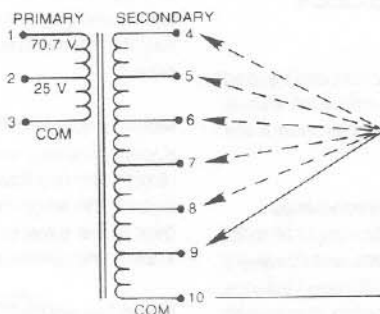


FIGURE 5 — Transformer Wiring

ARCHITECTS' AND ENGINEERS' SPECIFICATIONS

The loudspeaker(s) shall be of the compression-driver type utilizing a rugged phenolic diaphragm and a high temperature rated 1.5-inch diameter voice coil.

The loudspeaker(s) shall exhibit essentially flat power response from 500 to 4,000 Hz with a smoothly rolled-off response beyond. Their sensitivity, when mounted on a University Sound PH horn, will be 107 dB (1 W/1 M) with a 500-to-5,000 Hz pink noise signal applied.

The loudspeaker(s) shall be capable of handling a 30-watt, 500-to-5,000-Hz pink noise signal with a 6-dB crest factor for a period of 8 hours.

The loudspeaker(s) shall have a diameter of 10.6 cm (4.2 in.) and a depth of 13.2 cm (5.2 in.). They shall have a 2.41 cm (0.95 in.) throat opening with a 1 3/8-18 thread for mounting.

The loudspeakers shall be the University Sound ID30CT, which includes a 70 V/25 V line matching transformer (see Table II) and weighs no more than 2.1 kg (4.5 lb), and the University Sound ID30C-8, which has a nominal impedance of 8 ohms (or ID30C-16 with 16-ohm impedance) and weighs no more than 1.6 kg (3.5 lb).

WARRANTY (Limited) — University Sound Speakers and Speaker Systems (excluding active electronics) are guaranteed for five years from date of original purchase against malfunction due to defects in workmanship and materials. If such malfunction occurs, unit will be repaired or replaced (at our option) without charge for materials or labor if delivered prepaid to University Sound. Unit will be returned prepaid. Warranty does not extend to finish, appearance items, burned coils, or malfunction due to abuse or operation under other than specified conditions, including cone and/or coil damage resulting from improperly designed enclosures, nor does it extend to incidental or consequential damages. Some states do not allow the exclusion of limitation of incidental or consequential damages, so the above exclusion may not apply to you. Repair by other than University Sound will void this guarantee. This warranty gives you specific legal rights, and you may also have other rights which vary from state to state.

Service and repair information for this product: University Sound, Inc.,
Phone 818/362-9516. FAX 818/367-5292

Applications and technical information for University Sound products:
University Sound, Inc. Technical Coordinator, Phone 818/362-9516.
FAX 818/367-5292.

Specifications subject to change without notice

BASIC GUIDELINES FOR THE USE OF HORNS AND DRIVERS WITHIN A SOUND SYSTEM.

DESIGNING FOR INTELLIGIBILITY AND ADEQUATE SPL

The Basic Idea

Many sound systems would have better performance if the following basic principles are kept in mind. Speakers with the appropriate coverage patterns should be chosen, aimed and powered to achieve a uniform direct field in the highly absorptive audience, with no sound aimed at the reflective wall and ceiling surfaces. Where multiple speakers are required in order to achieve a uniform direct field, their coverage patterns should be only slightly overlapped, so that each section of the audience is covered by a single speaker. To the extent this ideal is achieved, reverberation is minimized and intelligibility is maximized.

The following material explains these concepts in more detail and illustrates two design approaches.

What is Reverberation?

Reverberation is the persistence of sound within an enclosure, such as a room, after the original sound has ceased. Reverberation may also be considered as a series of multiple echoes so closely spaced in time that they merge into a single continuous sound. These echoes decrease in level with successive reflections, and eventually are completely absorbed by the room.

Non-Reverberant Environments

An open, outdoor space is considered to be a non-reverberant environment, as virtually all sound escapes the area without reflection.

Variations in Level Due to Distance for Non-Reverberant Environments

In non-reverberant environments, such as outdoors, sound pressure level will be reduced by half (6 dB) every time the distance from the speaker is doubled (this is called the inverse-square law). Figure A shows the dB losses to be expected as distance from the speaker is increased from the one-meter (3.28-foot) measuring distance typically used in SPL specifications.

Reverberant Environments

Where sound is reflected from walls and other surfaces, there is a point beyond which the "reverberant field" dominates and the sound pressure level is higher and more constant than predicted by using the inverse-square law alone.

Variations in Level Due to Distance for Reverberant Environments


The reverberant field will begin to dominate typically at distances of 10 to 30 feet. This distance is greatest for the least reverberant rooms and speakers with narrow beamwidth angles. The frequency and beamwidth specifications provided by the data sheet are still required to obtain satisfactory distribution of the direct sound (or direct field) from the loudspeaker(s), which still follows the inverse-square law. It is the direct signal that contributes to speech intelligibility. This is why the sound system designer should seek a uniform direct field, with as little reverberant field as possible. For example, consider a single speaker with a wide beamwidth angle used to cover a long, narrow, reverberant room. The direct field will be so far below the reverberant field at the back of the room that speech will probably be unintelligible.

Calculating Variations in Level Due to Changes in Electrical Power

Each time the power delivered to the speaker is reduced by one-half, a level drop of 3 dB occurs. The nomograph of Figure B shows the change in dB to be expected as the power varies from the one-watt input typically used in SPL specifications.

Power Handling

The power rating of a speaker must be known to determine whether a design is capable of meeting the sound pressure level requirements of the system. The power rating combined with the sensitivity will enable a system designer to calculate the maximum sound pressure level attainable at a given distance.

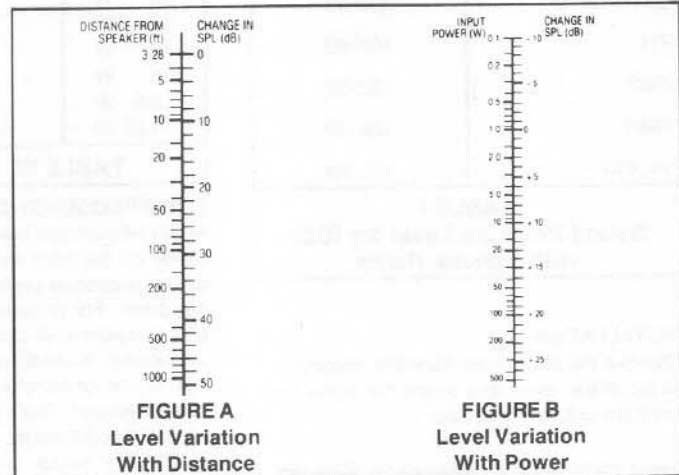

Powering to Achieve Both Average and Peak SPL

The average power that must be delivered to the speaker(s) to achieve the desired average SPL can be determined from the previously presented material on speaker sensitivity, level variation with distance and level variation with power. Enough additional power must be available to reproduce without distortion the short-term peaks that exist in voice and music program. This difference between the peak and average capability of a sound system, when expressed in dB, is often called "peak-to-average ratio," "crest factor" or "headroom." The peaks can be large, as noted earlier: at least 10 times the average (10 dB).

The better sound systems are designed for peaks that are 10 dB above the average, although 6 dB of headroom is sufficient for most general-purpose voice paging systems. The 10-dB peaks require amplifier power ten times that required for the average sound levels. The 6-dB peaks require four times the power.

Utilizing Speaker Beamwidth Information for Maximum Intelligibility

Knowing the beamwidth angle of a loudspeaker can aid in providing a uniform direct field in the listening area. After selecting a desired speaker location, the beamwidth angle needed to adequately cover the listeners without spilling over to the walls or ceilings must be determined. Once these angles are known, the correct speaker can be found by using catalog specifications.

Using Easy-VAMP™ and Floor-Plan Isobars

In some circumstances, it is desirable to use an approach that is more detailed than using the basic horizontal and vertical beamwidth angles. Environments which have excessive reverberation or high ambient noise levels make it especially difficult to achieve the desired SPL and intelligibility.

In recent years, a number of computer-based techniques have been developed to help sound system designers. Some of the more complex systems use personal computers, with relatively sophisticated graphics. Simpler systems, such as Electro-Voice's VAMP™ (Very Accurate Mapping Program), utilize clear overlays and require programmable scientific calculators. However, the hardware/software and training investment required to utilize even the simpler systems are not attractive to some sound systems designers. Because of this, University Sound has developed a special adaptation of VAMP, called Easy-VAMP™, which provides a similar design aid without the complexity and cost of the VAMP programs.

More information on both the Easy-VAMP™ and floor-plan isobars can be found in the University Sound Guide.

